OVE Austrian Electrotechnical Association
Eschenbachgasse 9 | 1010 Wien | Austria
ZVR: 327279890 | www.ove.at

OVE Certification
Kahlenberger Str. 2A | 1190 Wien | Austria
T +43 1 370 58 06 | certification@ove.at

Validity of ÖVE-Certificates can be checked at www.ove.at

ÖVE-CERTIFICATE

including the entitlement to use the Austrian Safety Mark

Certificate No.: **43-236-05**

Valid from: 2026 06 10
until: 2028 06 10

The Austrian Electrotechnical Association (OVE) hereby grants the right to the company mentioned below to label the listed products with the Austrian Safety Mark.

Certificate holder: **PC Electric Ges.m.b.H.**
Diesseits 145
4973 St. Martin im Innkreis
Austria

Product: **Plug for industrial purposes**

The products submitted by the applicant were type tested in accordance with the requirements of the technical standards and specifications listed in this certificate. OVE certifies the conformity of the listed products and those products manufactured strictly identical to the submitted ones (EN ISO/IEC 17067, Conformity Assessment Scheme Type 5).

The manufacturing process and the products are subject to ongoing surveillance based on harmonized European procedures. This certificate has been issued under the presumption and conditional on the fact that the certificate holder holds all necessary legal rights with regard to the product, presented for the testing and certification.

Results of testing are shown in file No(s).: **TGM-VA EE 39530**

Österreichischer Verband für Elektrotechnik
Head of OVE Certification

Digitally signed by T. Neumayer
Email=t.neumayer@ove.at

Wien, 2026 05 26

Dipl.-Ing. T. Neumayer

Manufacturer:

PC Electric Ges.m.b.H.
Diesseits 145
4973 St. Martin im Innkreis
Austria

Factory location(s):

PC Electric Ges.m.b.H.
Diesseits 145
4973 St. Martin im Innkreis
Austria

Tested and certified according to:


ÖVE/ÖNORM EN 60309-1:2013-03-01
OVE EN IEC 60309-1:2023-07-01
IEC 60309-1:2021

This certificate is the basis for the EU Declaration of Conformity and the CE Marking by the manufacturer or his agent and shows the conformity of the certified product(s) with the listed standards as defined by the **EU Low-Voltage Directive 2014/35/EU**. For the presumption of conformity according to Art. 12 with the safety objectives according to Art. 3 of the Directive, transitional periods given in the Official Journal of the European Union have to be observed.

Product: Plug for industrial purposes

Type designation: *Rating:*	***Trademark:***
027 Rated supply current: 32 A Insulation Voltage: 500 V 6P+E (not standardized) IP44 or IP44/IP54	PCE / ELCEE
8027 Rated supply current: 32 A Insulation Voltage: 500 V 6P+E (not standardized) IP44 or IP44/IP54	PCE / ELCEE
0272 Rated supply current: 32 A Insulation Voltage: 500 V 6P+E (not standardized) IP67 or IP66/IP67	PCE / ELCEE
80272 Rated supply current: 32 A Insulation Voltage: 500 V 6P+E (not standardized) IP67 or IP66/IP67	PCE / ELCEE

Typecode

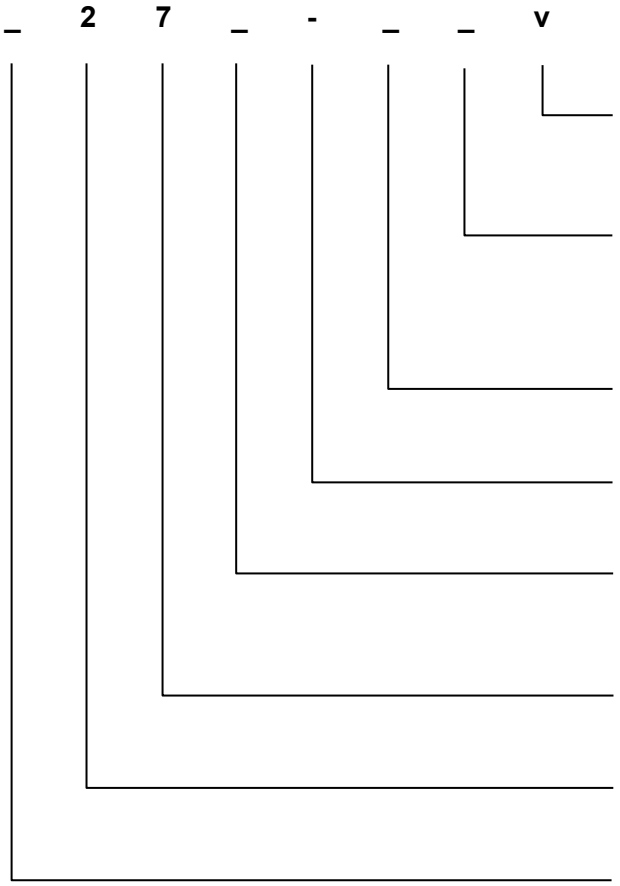

Contacts
blank - uncoated contacts
v - Nickel plated contacts

Colour
blank - Identification colour
x - Special design
* - Reserved for additional colours

Clock position earthing contact
1, 2, 3, 4, 6, 7, 9, 10, 11, 12

Customer type
- - PCE

Degree of protection
blank - IP44 or IP44/IP54
2 - IP67 or IP66/IP67

Poles
7 - 7-poles

Rated current
2 - 32A

Basic type
0 - Plug
80 - Angled plug

Typelist

Type	Rated current [A]	Earthing contact position [h]	Degree of protection	Rated operating voltage [V]	Frequency [Hz]	Insulation voltage [V]
027 **8027**	32	1	IP44 or IP44/IP54	Other ratings	Other ratings	500
		2		> 50	> 300 - 500	500
		3		380 440	50 60	500
		4		100 - 130	50 and 60	500
		6		380 - 415	50 and 60	500
		7		480 - 500	50 and 60	500
		9		200 - 250	50 and 60	500
		10		> 50	> 100 - 300	500
		11		440 - 460	60	500
		12		Supply from an isolating transformer	50 and 60	500
0272 **80272**	32	1	IP67 or IP66/IP67	Other ratings	Other ratings	500
		2		> 50	> 300 - 500	500
		3		380 440	50 60	500
		4		100 - 130	50 and 60	500
		5		600 - 690	50 and 60	500
		6		380 - 415	50 and 60	500
		7		480 - 500	50 and 60	500
		9		200 - 250	50 and 60	500
		10		> 50	> 100 - 300	500
		11		440 - 460	60	500
		12		Supply from an isolating transformer	50 and 60	500