



ÖVE-CERTIFICATE

including the entitlement to use the Austrian Safety Mark



Certificate No.: **43-170-15**

Valid from: 2024 03 18
until: 2025 06 17

The Austrian Electrotechnical Association (OVE) hereby grants the right to the company mentioned below to label the listed products with the Austrian Safety Mark.

Certificate holder: **PC Electric Ges.m.b.H.**
Diesseits 145
4973 St. Martin im Innkreis
Austria

Product: **Switched socket-outlets for industrial purposes**

The products submitted by the applicant were type tested in accordance with the requirements of the technical standards and specifications listed in this certificate. OVE certifies the conformity of the listed products and those products manufactured strictly identical to the submitted ones (EN ISO/IEC 17067, Conformity Assessment Scheme Type 5).

The manufacturing process and the products are subject to ongoing surveillance based on harmonized European procedures. This certificate has been issued under the presumption and conditional on the fact that the certificate holder holds all necessary legal rights with regard to the product, presented for the testing and certification.

Results of testing are shown in file No(s): **3795-1877/24**

Österreichischer Verband für Elektrotechnik
Head of OVE Certification

T. Neumayer
Digitally signed by T. Neumayer
Email=t.neumayer@ove.at



Wien, 2024 03 18

Dipl.-Ing. T. Neumayer

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.



Manufacturer:

PC Electric Ges.m.b.H.
Diesseits 145
4973 St. Martin im Innkreis
Austria

Factory location(s):

PC Electric Ges.m.b.H.
Diesseits 145
4973 St. Martin im Innkreis
Austria

Tested and certified according to:

ÖVE/ÖNORM EN 60309-1:2013-03-01
ÖVE/ÖNORM EN 60309-2:2013-03-01
ÖVE/ÖNORM EN 60309-4:2012-12-01
OVE EN IEC 60309-1:2023-07-01
OVE EN IEC 60309-2:2023-07-01
OVE EN IEC 60309-4:2023-04-01

This certificate is the basis for the EU Declaration of Conformity and the CE Marking by the manufacturer or his agent and shows the conformity of the certified product(s) with the listed standards as defined by the **EU Low-Voltage Directive 2014/35/EU**. For the presumption of conformity according to Art. 12 with the safety objectives according to Art. 3 of the Directive, transitional periods given in the Official Journal of the European Union have to be observed.

Product: Switched socket-outlets for industrial purposes

Type designation:

Rating:

Trademark:

75331

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 44
without pilot contact

PCE / ELCEE

75332

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 67 or IP 66/IP 67
without pilot contact

PCE / ELCEE

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.

76331

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 44
without pilot contact

PCE / ELCEE

76332

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 67 or IP 66/IP 67
without pilot contact

PCE / ELCEE

753315

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 44
with pilot contact

PCE / ELCEE

753325

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 67 or IP 66/IP 67
with pilot contact

PCE / ELCEE

763315

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 44
with pilot contact

PCE / ELCEE

763325

Rated current: 63 A
Insulation voltage: 690 V
2P+PE
IP 67 or IP 66/IP 67
with pilot contact

PCE / ELCEE

75341

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 44
without pilot contact

PCE / ELCEE

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.

75342

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 67 or IP 66/IP 67
without pilot contact

PCE / ELCEE

76341

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 44
without pilot contact

PCE / ELCEE

76342

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 67 or IP 66/IP 67
without pilot contact

PCE / ELCEE

753415

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 44
with pilot contact

PCE / ELCEE

753425

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 67 or IP 66/IP 67
with pilot contact

PCE / ELCEE

763415

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 44
with pilot contact

PCE / ELCEE

763425

Rated current: 63 A
Insulation voltage: 690 V
3P+PE
IP 67 or IP 66/IP 67
with pilot contact

PCE / ELCEE

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.

75351

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 44
without pilot contact

PCE / ELCEE

75352

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 67 or IP 66/IP 67
without pilot contact

PCE / ELCEE

76351

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 44
without pilot contact

PCE / ELCEE

76352

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 67 or IP 66/IP 67
without pilot contact

PCE / ELCEE

753515

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 44
with pilot contact

PCE / ELCEE

753525

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 67 or IP 66/IP 67
with pilot contact

PCE / ELCEE

763515

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 44
with pilot contact

PCE / ELCEE

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.

763525

Rated current: 63 A
Insulation voltage: 690 V
3P+N+PE
IP 67 or IP 66/IP 67
with pilot contact

PCE / ELCEE

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.

Typelist

Type	Rated current [A]	Earthing contact pos. [h]	Rated operating voltage [V]	Frequency [Hz]	Insulation Voltage [V]
75331 753315* 76331 763315*	63	1	Other ratings	Other ratings	690
		4	100 - 130	50 and 60	690
		6	200 - 250	50 and 60	690
		7	480 - 500	50 and 60	690
		9	380 – 415	50 and 60	690
		12	Supply from an isolating transformer	50 and 60	690
75341 753415* 76341 763415*	63	1	Other ratings	Other ratings	690
		3	380 440	50 60	690
		4	100 - 130	50 and 60	690
		5	600 – 690	50 and 60	690
		6	380 - 415	50 and 60	690
		7	480 - 500	50 and 60	690
		9	200 - 250	50 and 60	690
		11	440 - 460	60	690
		12	Supply from an isolating transformer	50 and 60	690
75351 753515* 76351 763515*	63	1	Other ratings	Other ratings	690
		3	220/380 250/440	50 60	690
		4	57/100 - 75/130	50 and 60	690
		5	347/600 – 400/690	50 and 60	690
		6	200/346 - 240/415	50 and 60	690
		7	277/480 - 288/500	50 and 60	690
		9	120/208 - 144/250	50 and 60	690
		11	250/440 - 265/460	60	690
		12	Supply from an isolating transformer	50 and 60	690

*with pilot contact

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.

Typelist

Type	Rated current [A]	Earthing contact pos. [h]	Rated operating voltage [V]	Frequency [Hz]	Insulation Voltage [V]
75332 753325* 76332 763325*	63	1	Other ratings	Other ratings	690
		4	100 - 130	50 and 60	690
		6	200 - 250	50 and 60	690
		7	480 - 500	50 and 60	690
		9	380 - 415	50 and 60	690
		12	Supply from an isolating transformer	50 and 60	690
75342 753425* 76342 763425*	63	1	Other ratings	Other ratings	690
		3	380 440	50 60	690
		4	100 - 130	50 and 60	690
		5	600 - 690	50 and 60	690
		6	380 - 415	50 and 60	690
		7	480 - 500	50 and 60	690
		9	200 - 250	50 and 60	690
		11	440 - 460	60	690
		12	Supply from an isolating transformer	50 and 60	690
75352 753525* 76352 763525*	63	1	Other ratings	Other ratings	690
		3	220/380 250/440	50 60	690
		4	57/100 - 75/130	50 and 60	690
		5	347/600 - 400/690	50 and 60	690
		6	200/346 - 240/415	50 and 60	690
		7	277/480 - 288/500	50 and 60	690
		9	120/208 - 144/250	50 and 60	690
		11	250/440 - 265/460	60	690
		12	Supply from an isolating transformer	50 and 60	690


*with pilot contact

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.

Typecode

7 • 3 • • • - • • • •

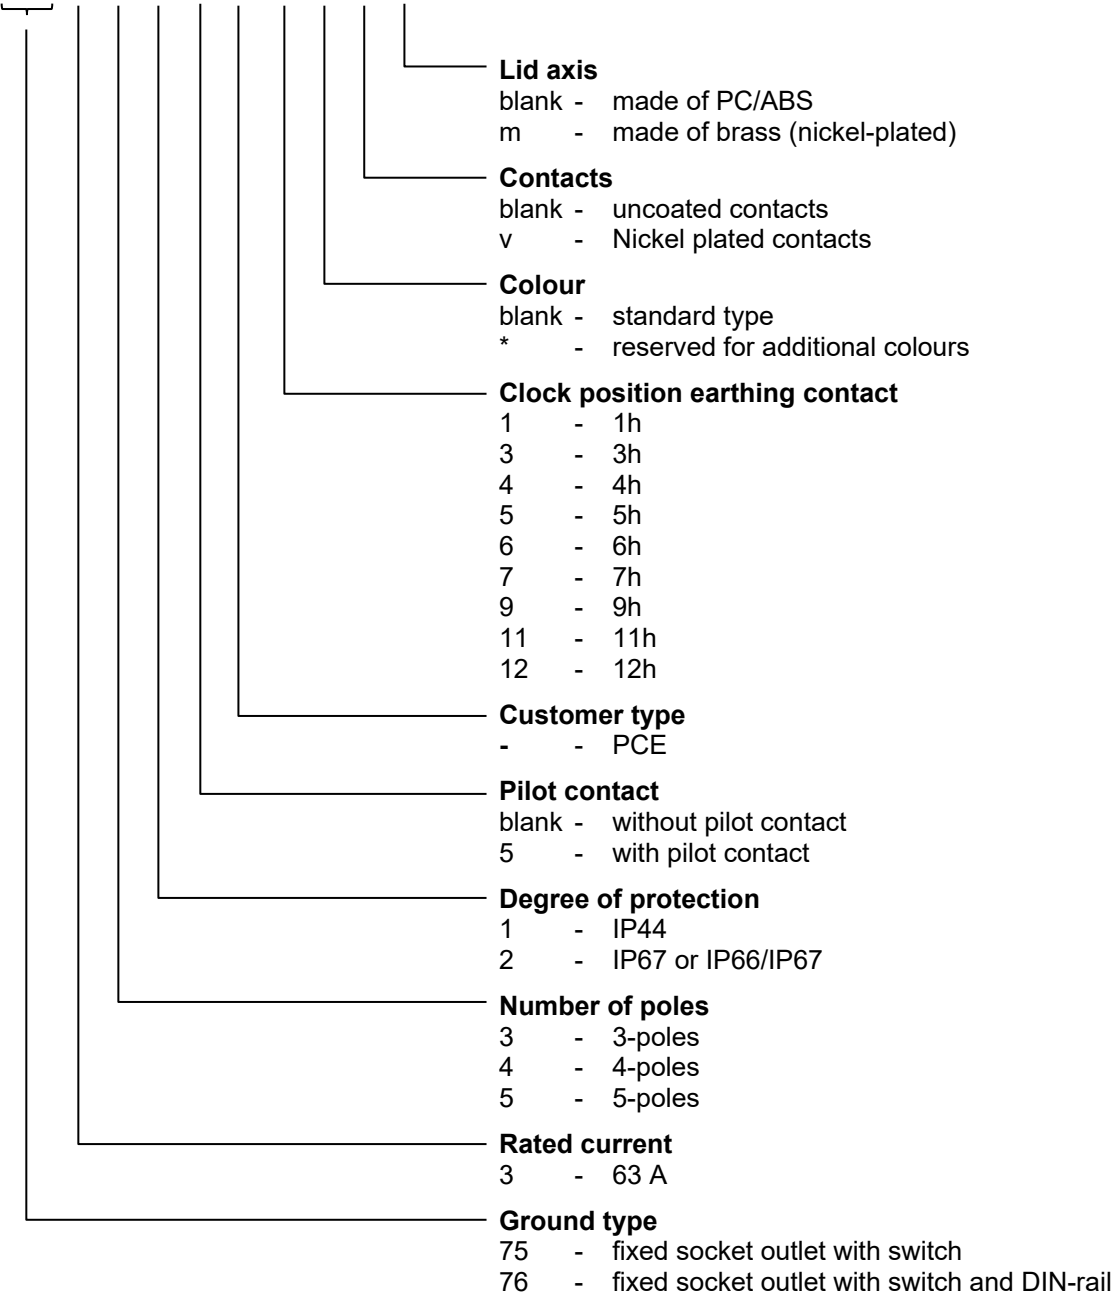

OVE Certification

Accredited by the Austrian National Accreditation Body as Certification Body for products within the scope as given in the official decree and published under <https://akkreditierung-austria.gv.at>.